



HYDRANT SPACING (FROM PR. HYDRANT @ STA. 1+13):  
 EAST - 215 LF TO EX. HYDRANT ON OSSIAN  
 WEST - 380 LF TO EX. HYDRANT AT OSSIAN/LINCOLN

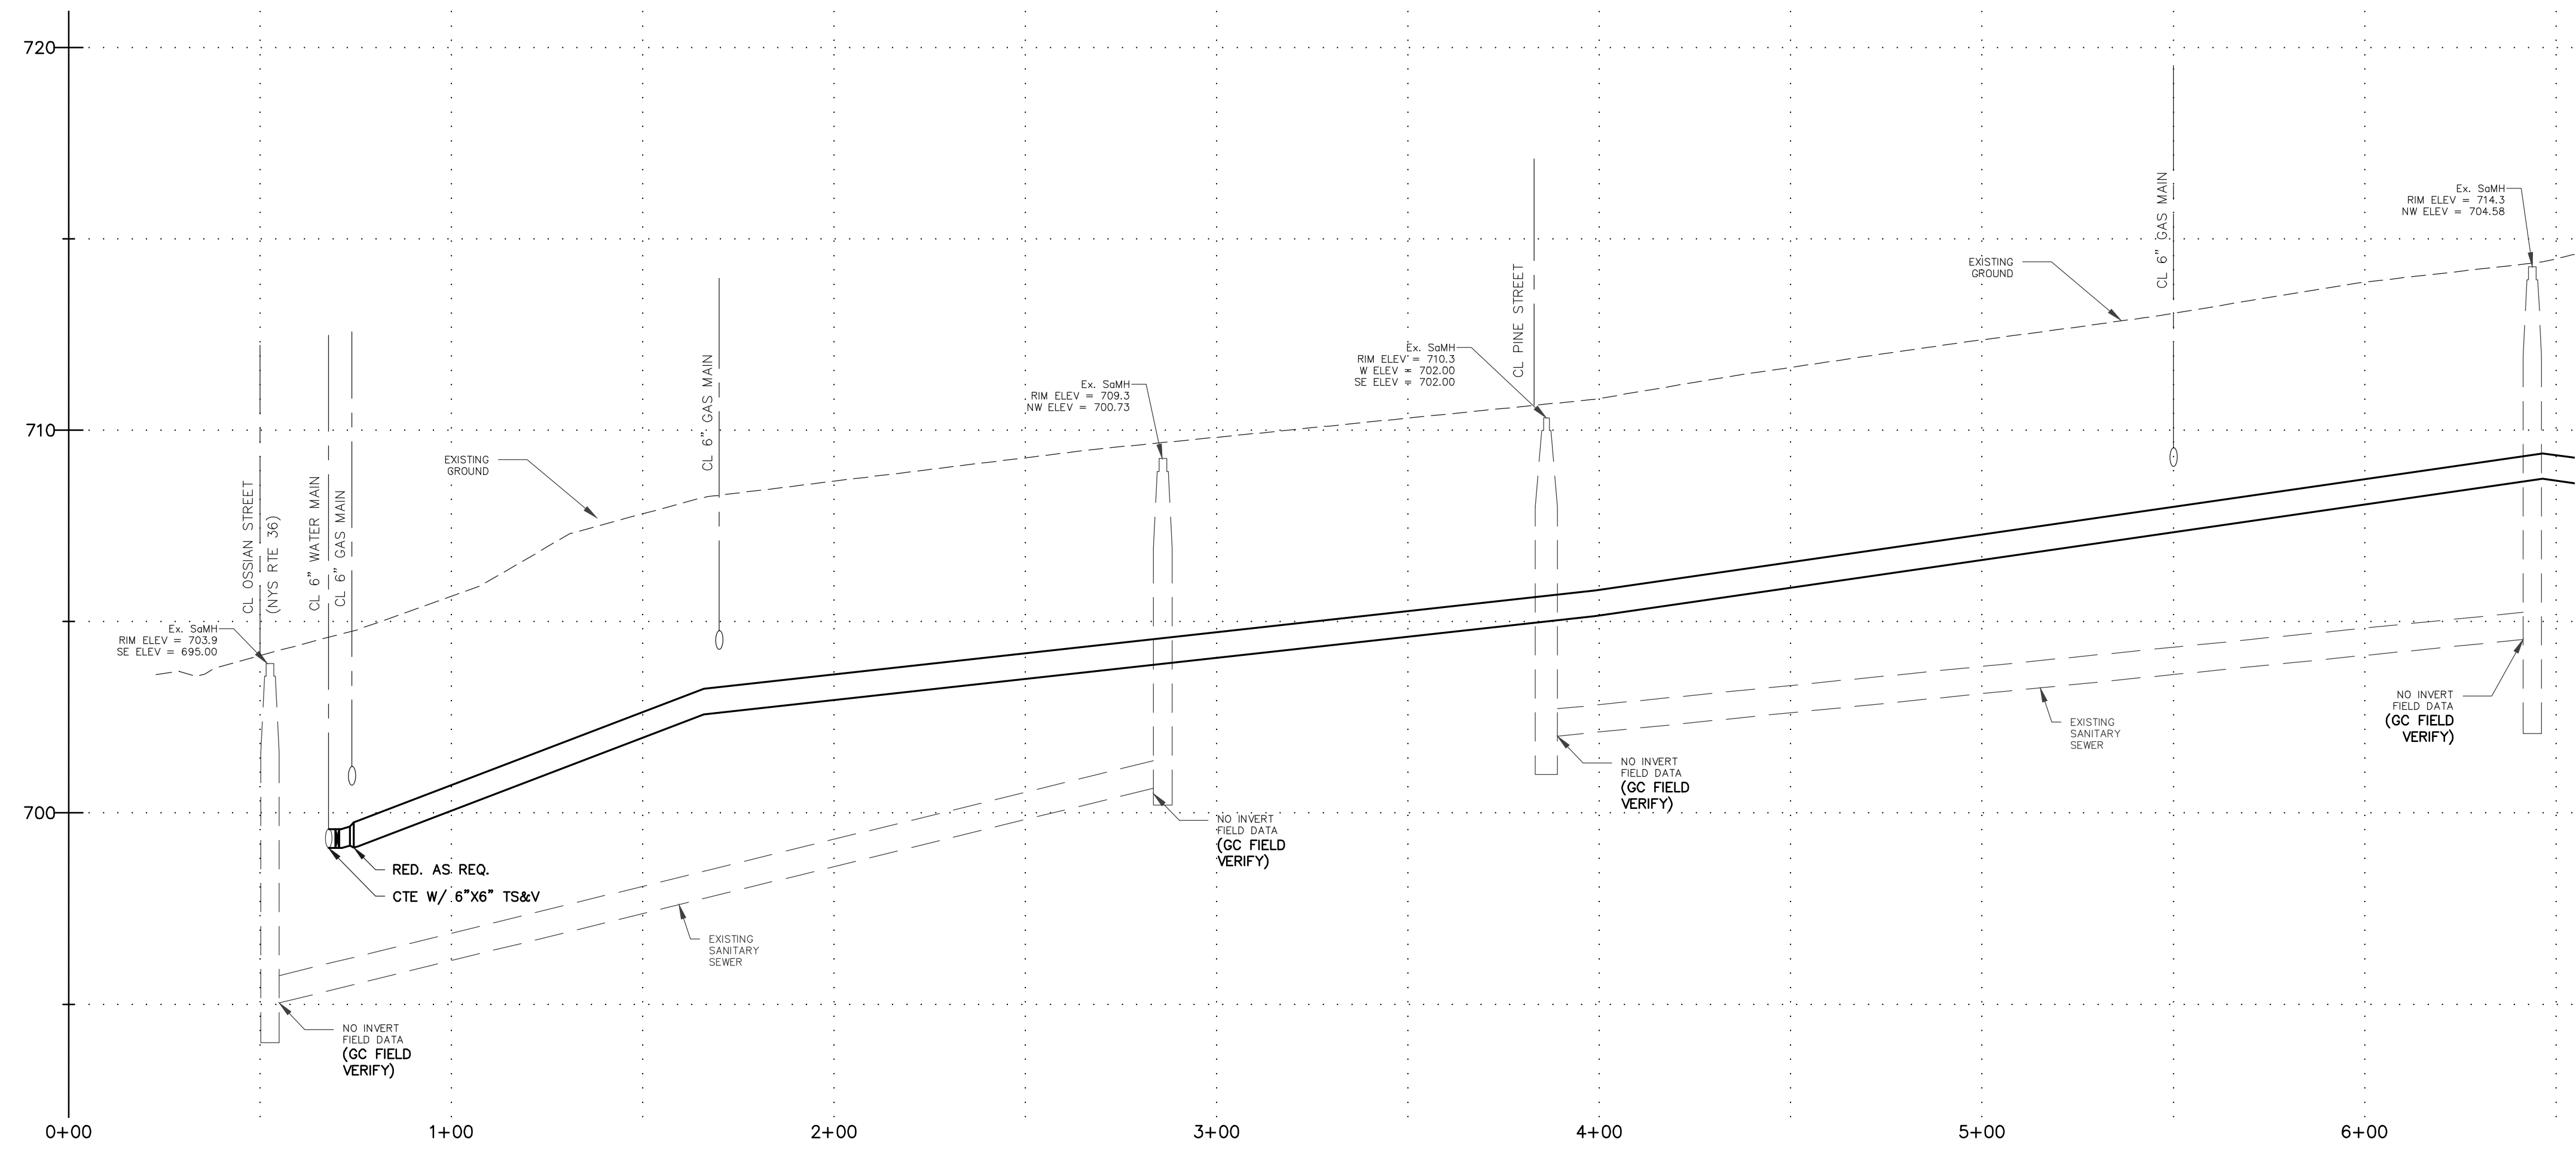

CENTERLINE SPRUCE AVENUE  
 HORIZ SCALE: 1" = 30'  
 VERT SCALE: 1" = 3'  
 (DIR. DRILL UNDER CLARA BARTON)

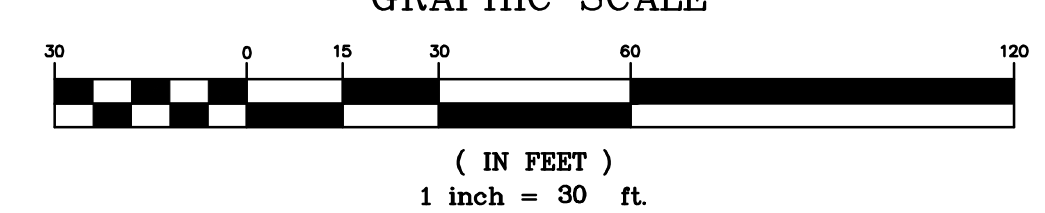

AS ISSUED FOR PRELIMINARY REVIEW

1.	ISSUED FOR INSDOH REVIEW	DAH	4/29/21
No.	Revisions and Descriptions	By	Date
Copyright © 2021 MRB Group All Rights Reserved			

Project Title: **VILLAGE WATER SYSTEM IMPROVEMENT PROJECT 2020 VILLAGE OF DANSVILLE LIVINGSTON COUNTY, NEW YORK**

Drawn By: BJJ  
 Checked By: GJH  
 Scale: AS SHOWN  
 Date: 1/2021

Drawing Title: **PLAN AND PROFILE**



SPRUCE STREET

**MRB group**  
 Engineering, Architecture & Surveying, D.P.C.  
 The Culver Road Armory, 145 Culver Road,  
 Suite 160, Rochester, New York 14620  
 Phone: 585-381-9250  
 www.mrbgroup.com


Sheet No. **G-48**  
 of **TOT**

Project No. **0410.20002**

DRAWING ALTERATION THE FOLLOWING IS AN EXCERPT FROM THE NEW YORK EDUCATION LAW ARTICLE 145 SECTION 7209 AND APPLIES TO THIS DRAWING. "IT IS A VIOLATION OF THIS LAW FOR ANY PERSON UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER OR LAND SURVEYOR TO ALTER AN ITEM IN ANY WAY. IF AN ITEM BEARING THE SEAL OF AN ENGINEER OR LAND SURVEYOR IS ALTERED, THE ALTERING ENGINEER OR LAND SURVEYOR SHALL AFFIX TO THE ITEM HIS SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY HIS SIGNATURE AND THE DATE OF SUCH ALTERATION AND A SPECIFIC DESCRIPTION OF THE ALTERATION."

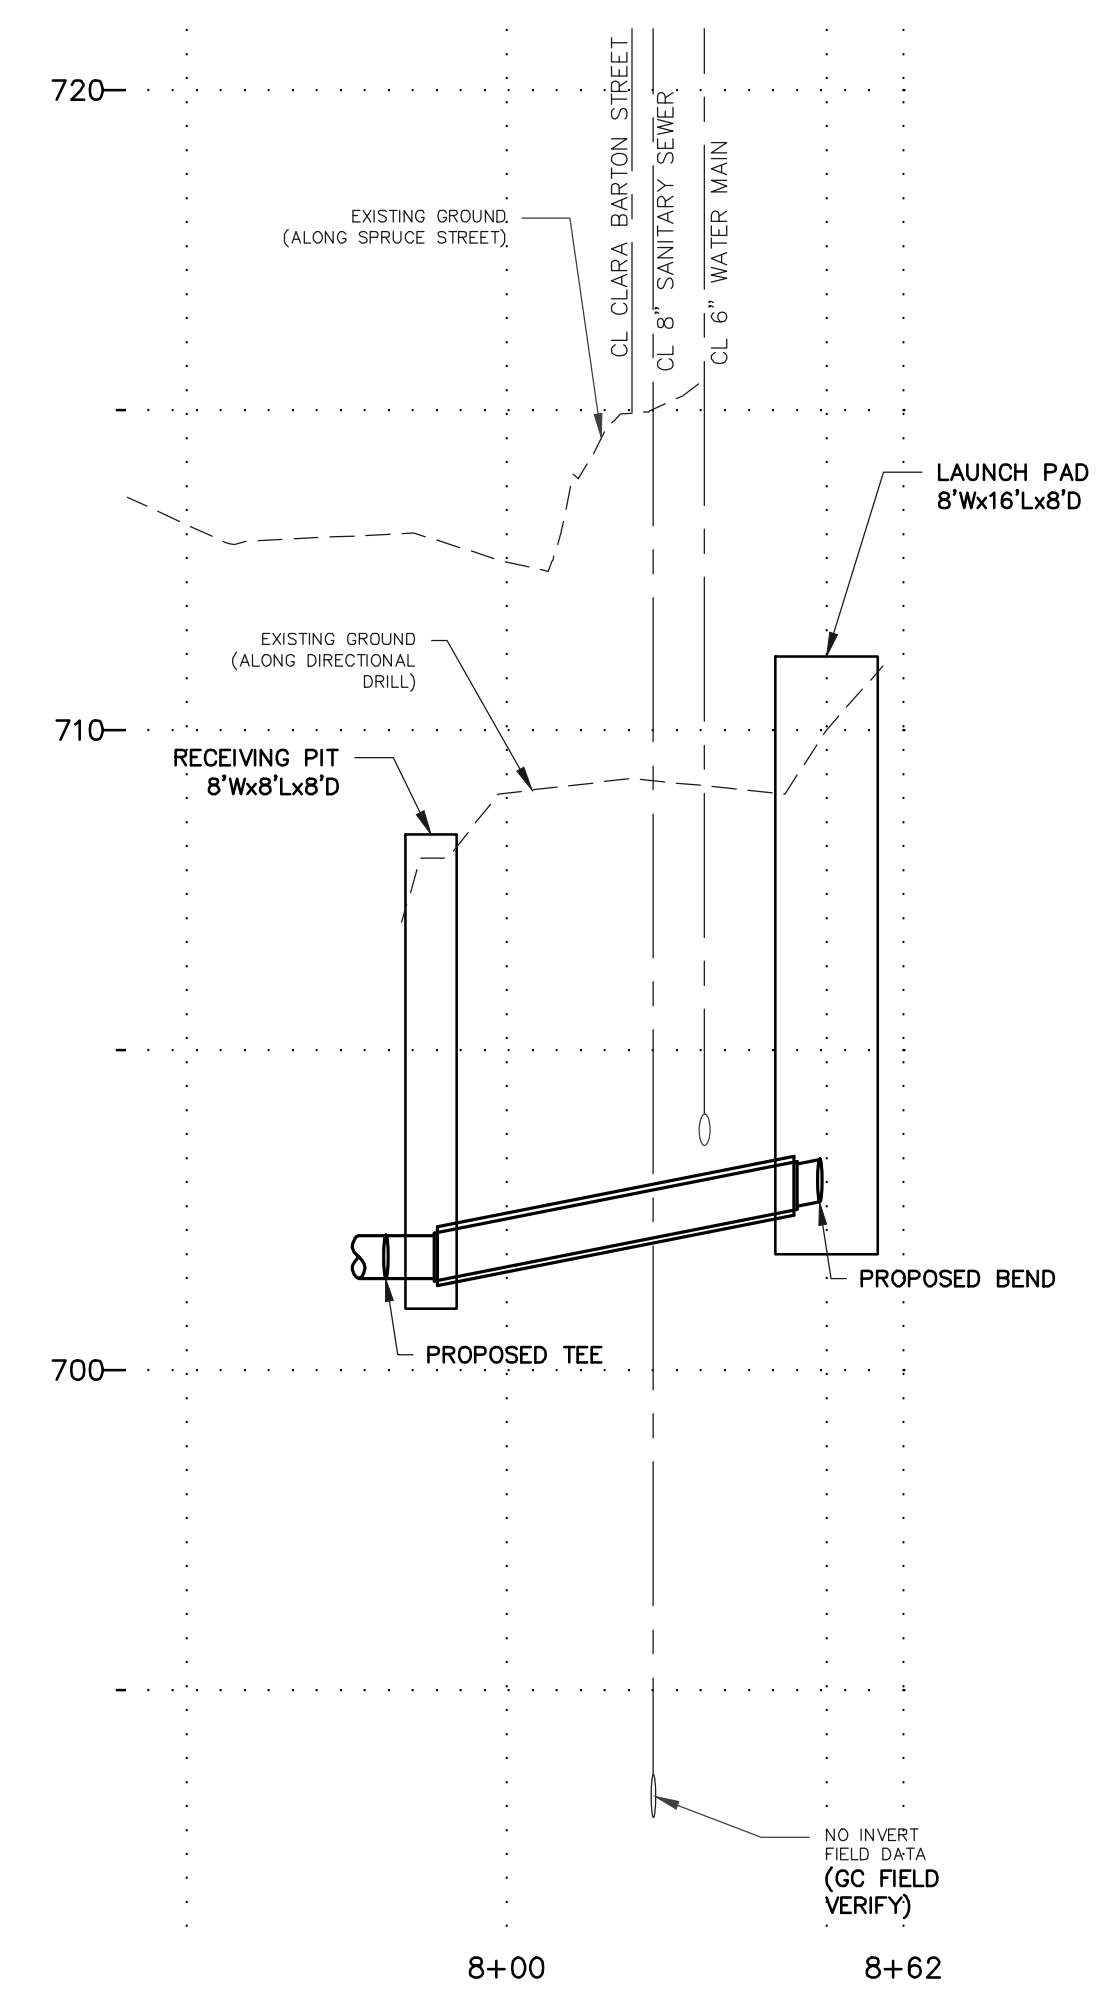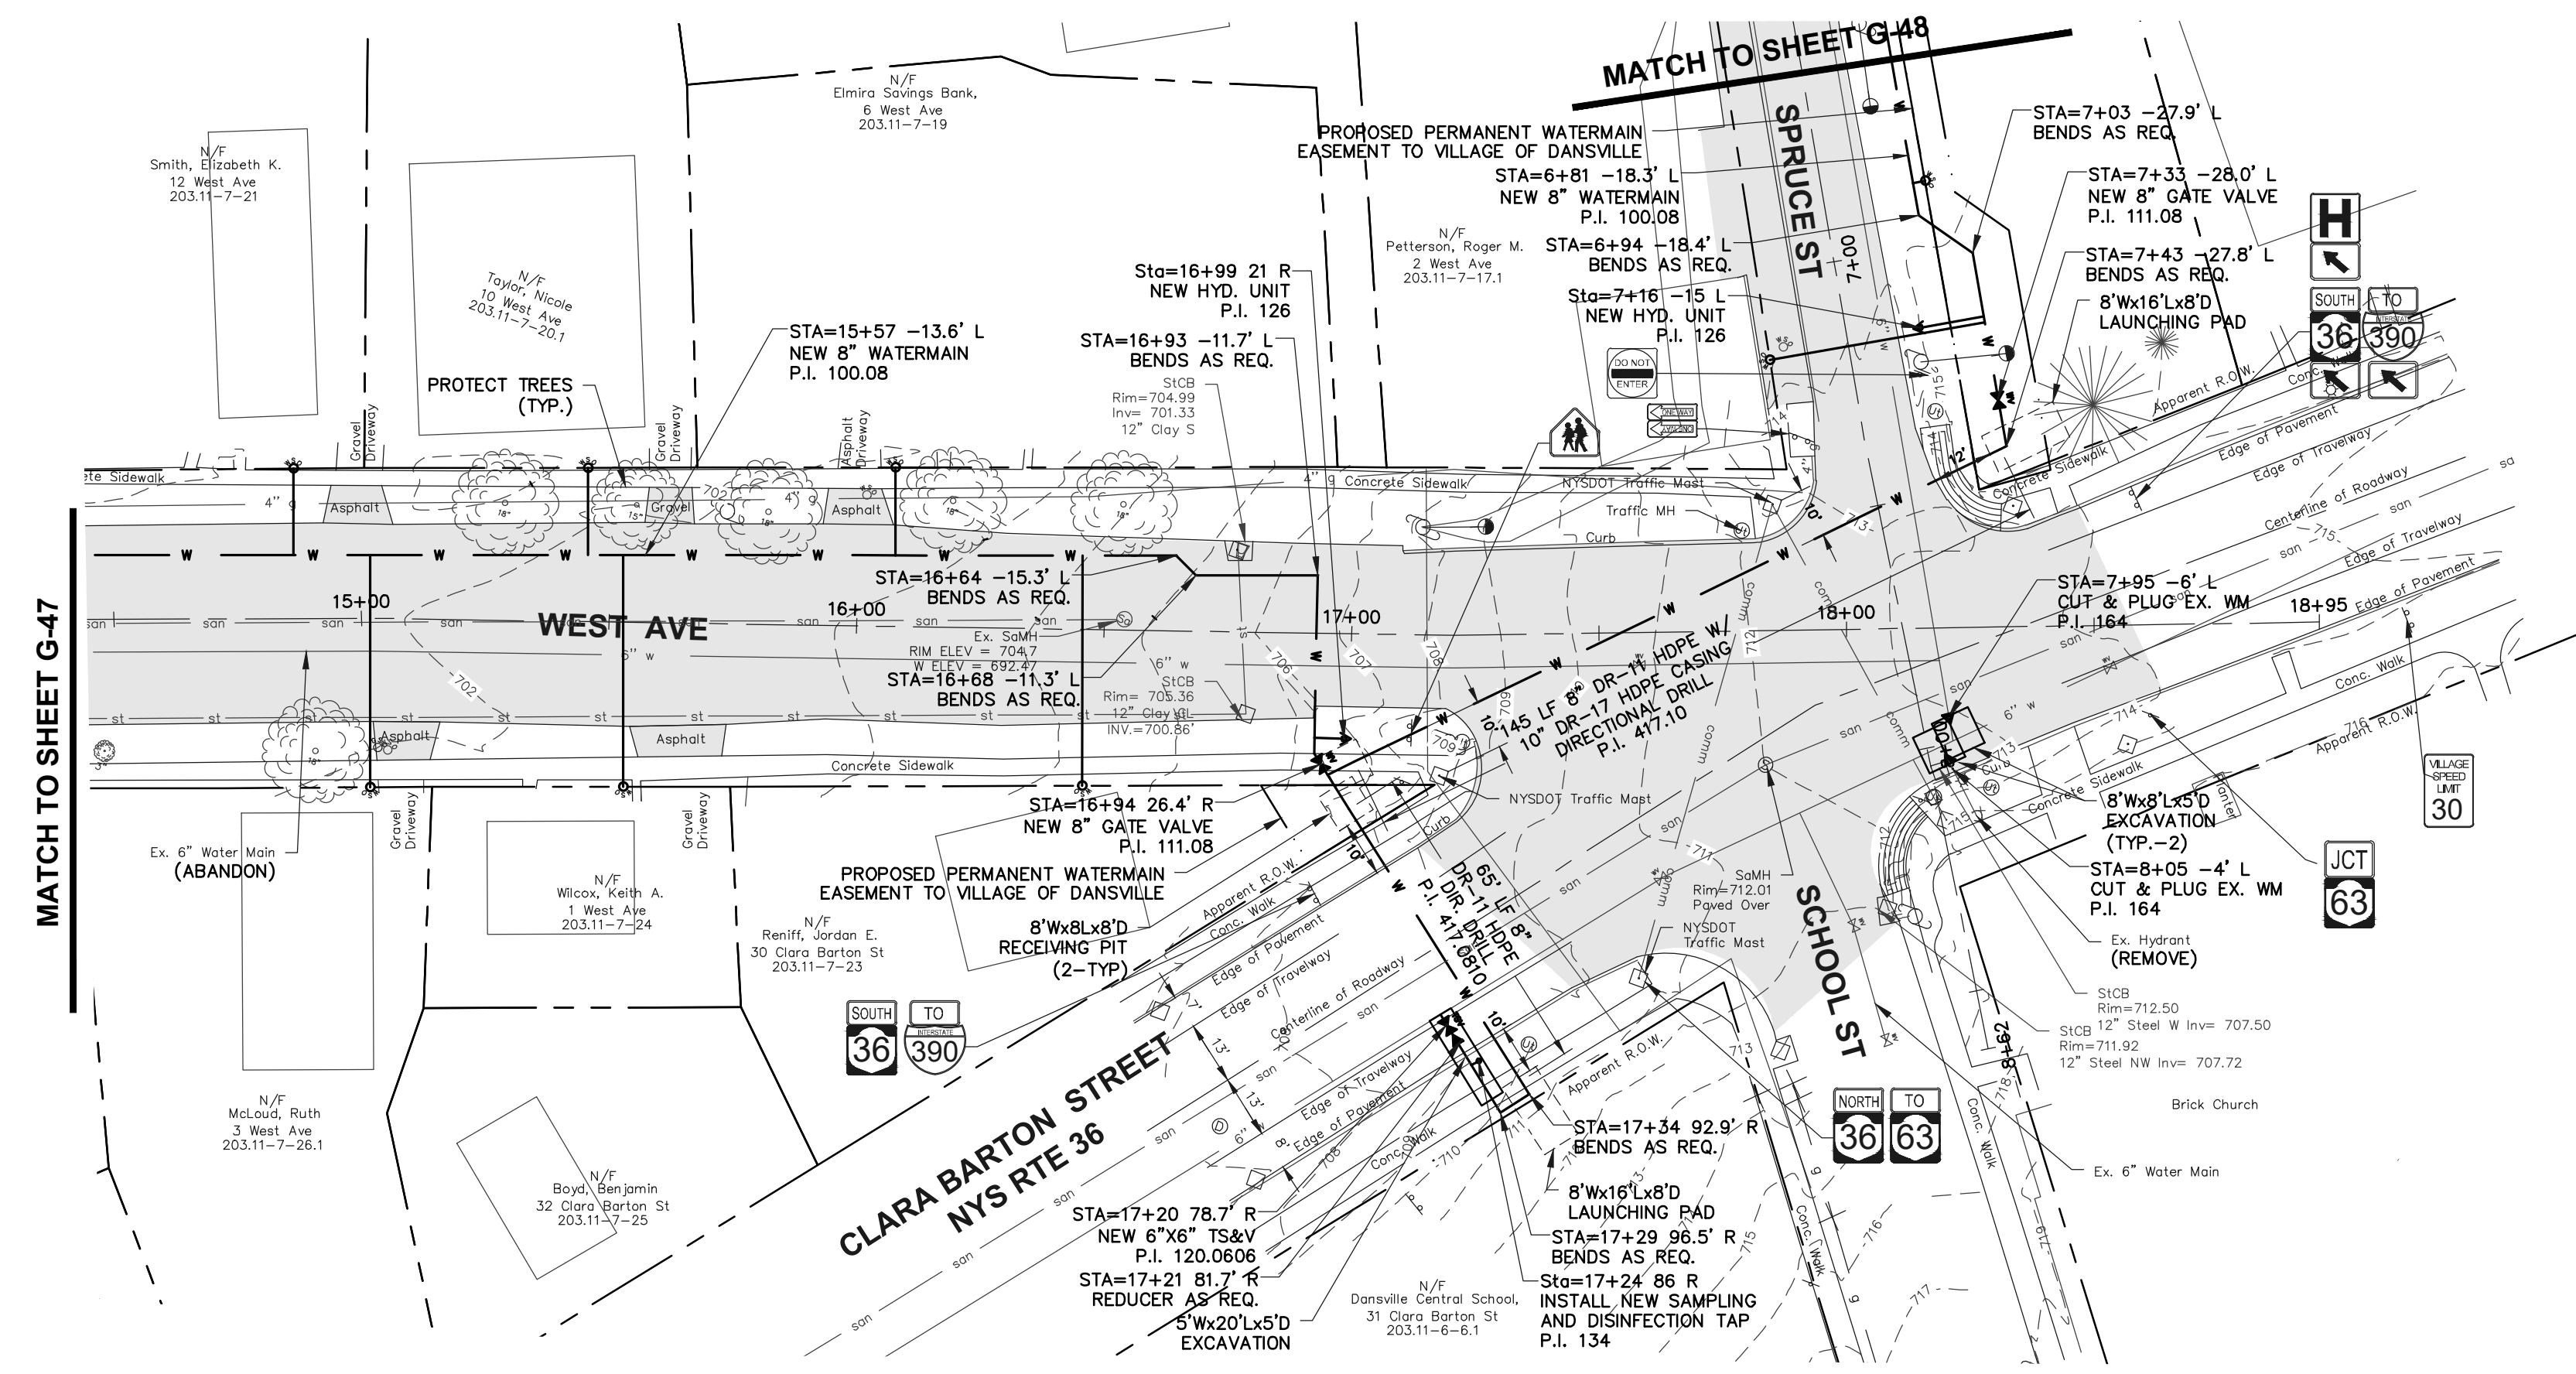


**CENTERLINE SPRUCE AVENUE**  
**HORIZ SCALE: 1" = 30'**  
**VERT SCALE: 1" = 3'**  
**(DIR. DRILL UNDER CLARA BARTON)**

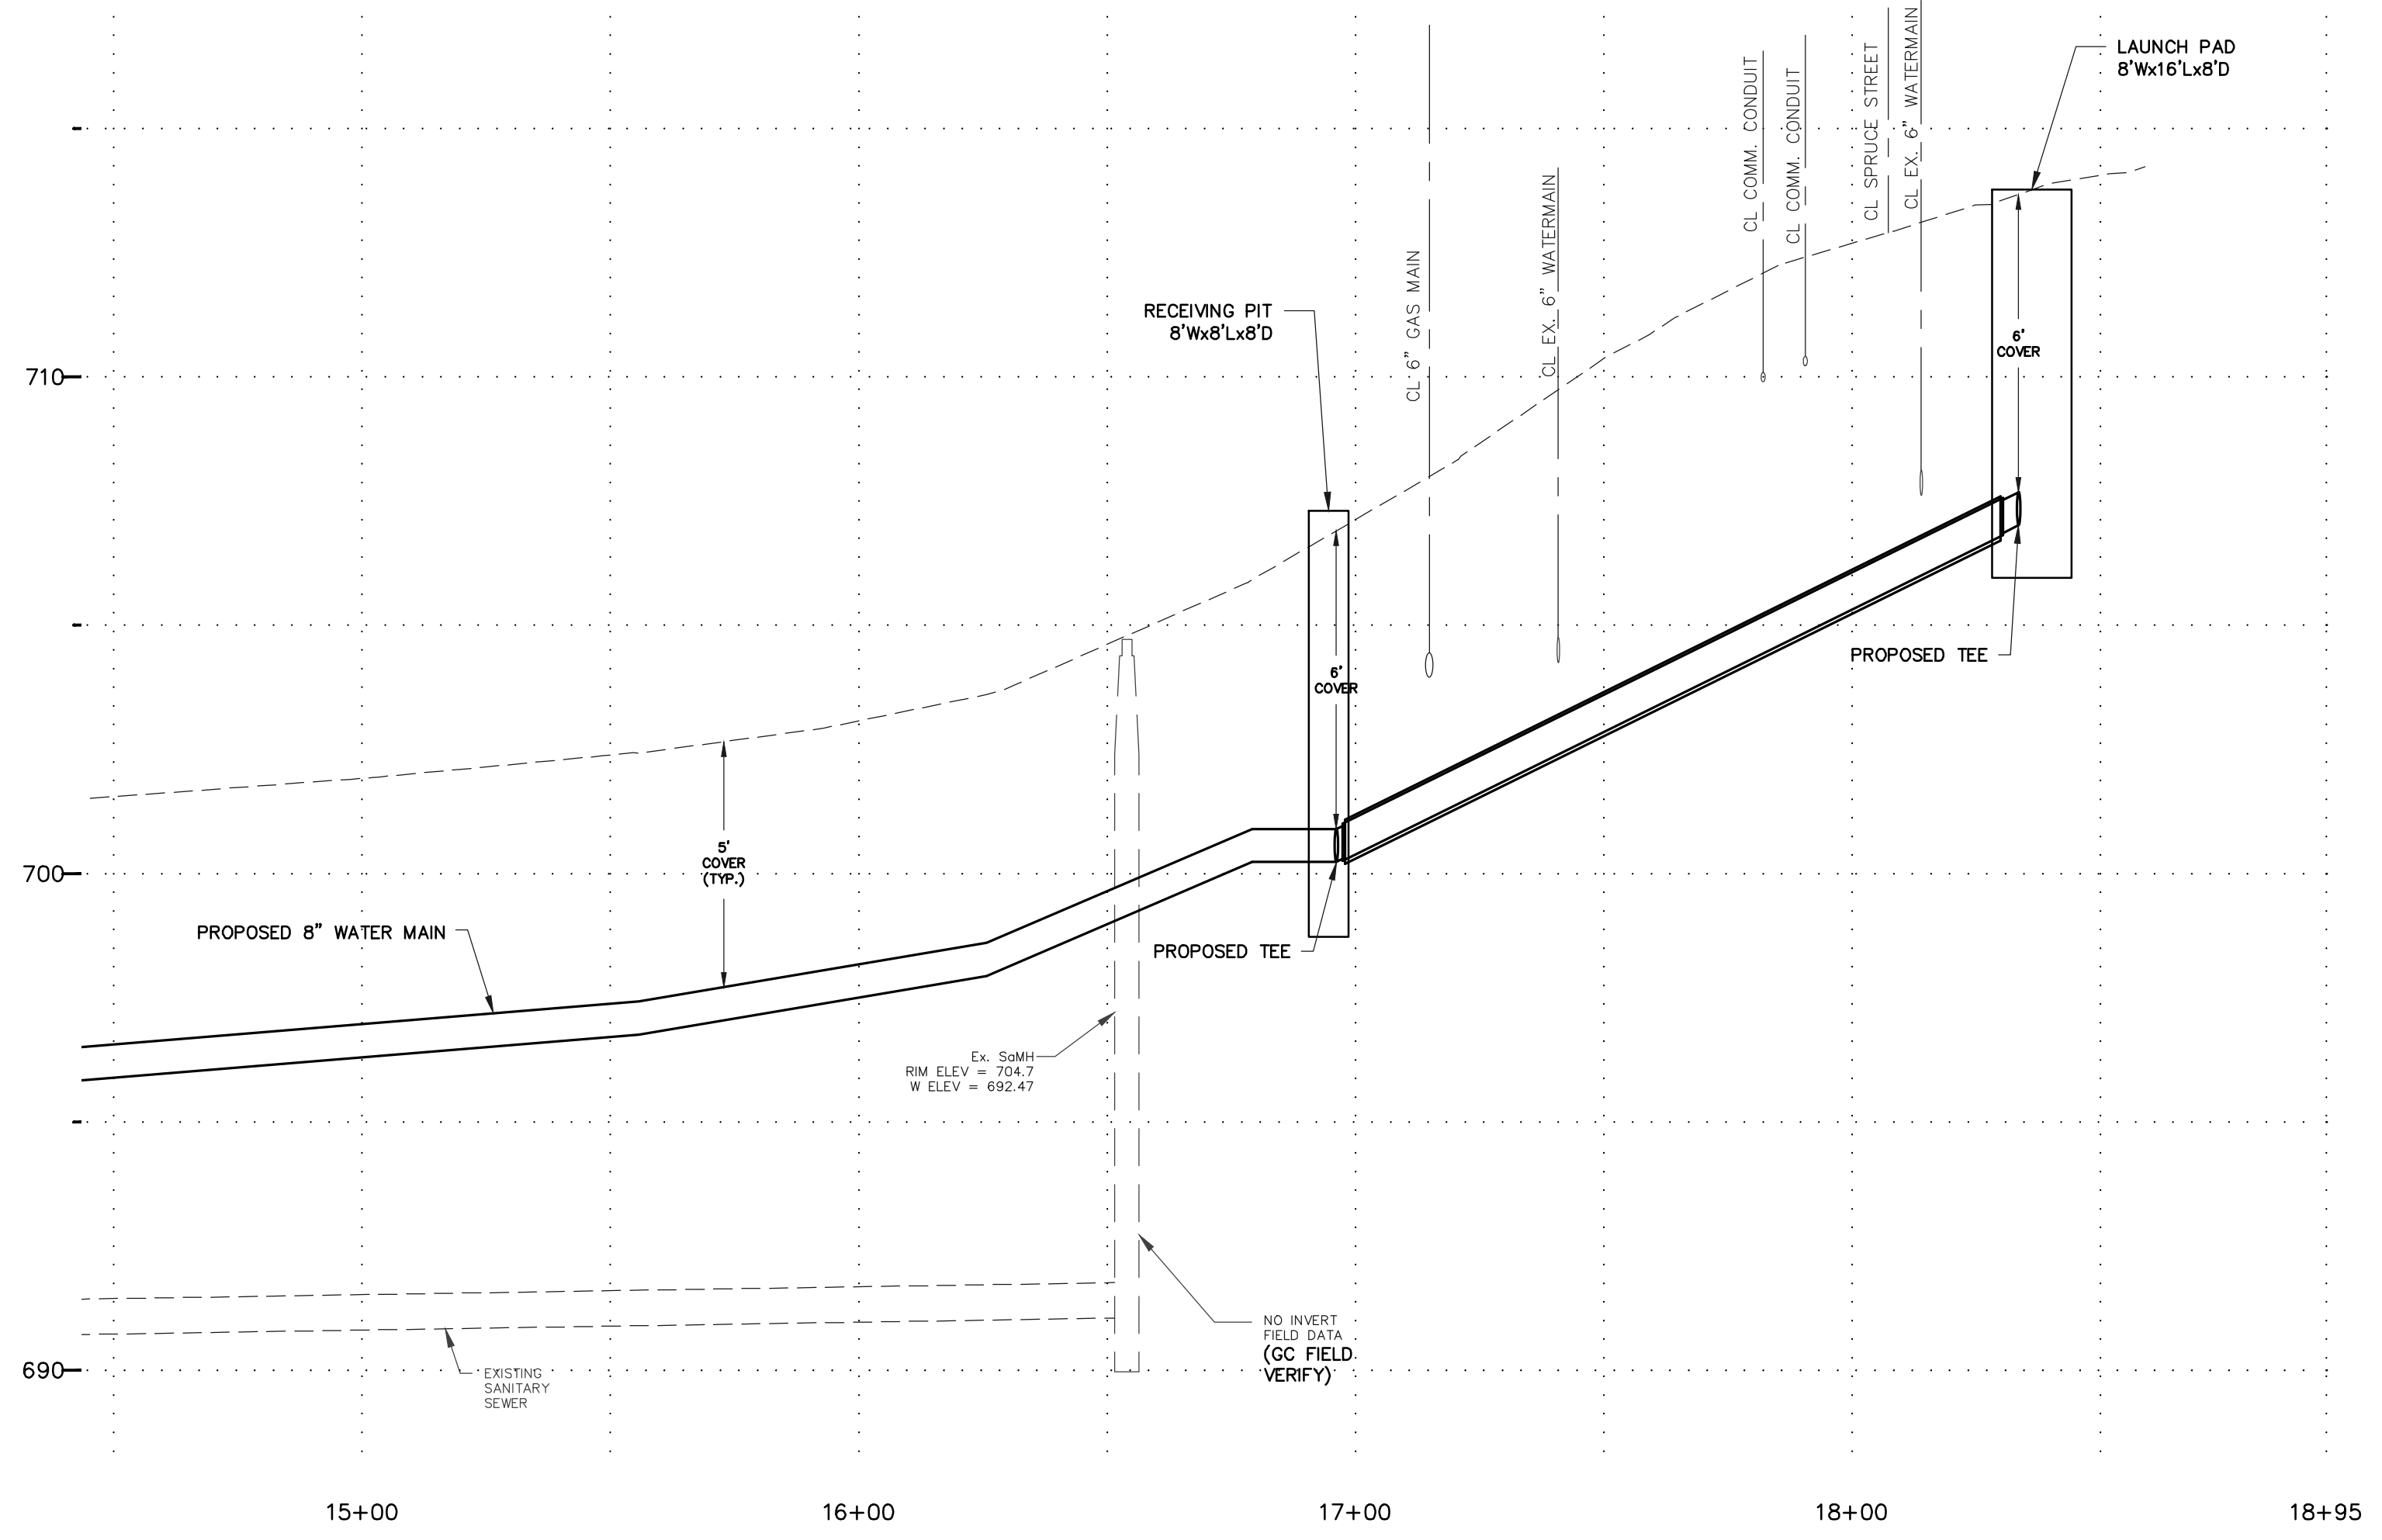

**CENTERLINE WEST AVE**  
**HORIZ SCALE: 1" = 30'**  
**VERT SCALE: 1" = 3'**

PIPE CROSSING - DATA SHEET		
CONTENTS TO BE HANDLED	PIPE DATA	
	CARRIER PIPE	CASING PIPE
	WATER	WATERMAIN
NORMAL OPERATING PRESSURE	100 #	ATMOSPHERIC
NOMINAL SIZE OF PIPE	8"	10"
OUTSIDE DIAMETER	9.050"	11.100"
INSIDE DIAMETER	7.30"	9.71"
WALL THICKNESS	0.823"	0.653"
WEIGHT PER FOOT	9.32#	9.41#
MATERIAL	HIGH DENSITY POLYETHYLENE	HIGH DENSITY POLYETHYLENE
PROCESS OF MANUFACTURE	EXTRUSION	EXTRUSION
SPECIFICATION	AWWA C906-99	AWWA C906-99
GRADE OR CLASS	DR-11	DR-17
TEST PRESSURE	150 PSI	0
TYPE OF JOINT	BUT FUSION	BUT FUSION
TYPE OF COATING	NONE	NONE
DETAILS OF CATHODIC PROTECTION	NONE	NONE
DETAILS OF SEAL OR PROTECTION	N.A.	N.A.
AT ENDS OF CASING		
METHOD OF INSTALLATION	DIRECTIONALLY DRILLED	DIRECTIONALLY DRILLED

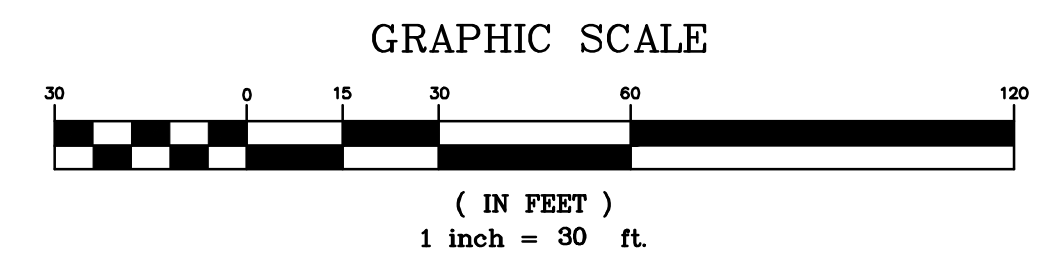

DRAWING ALTERATION: THE FOLLOWING IS AN EXCERPT FROM THE NEW YORK EDUCATION LAW ARTICLE 145 SECTION 7209 AND APPLIES TO THIS DRAWING. IT IS A VIOLATION OF THIS LAW FOR ANY PERSON UNLESS HE IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER OR LAND SURVEYOR TO ALTER AN ITEM THAT BEARING THE SEAL OF AN ENGINEER OR LAND SURVEYOR IS ALTERED. THE ALTERING ENGINEER OR LAND SURVEYOR SHALL AFFIX TO THE ITEM HIS SEAL AND THE NOTATION "ALTERED BY" FOLLOWED BY HIS SIGNATURE AND THE DATE OF SUCH ALTERATION AND A SPECIFIC DESCRIPTION OF THE ALTERATION.

**AS ISSUED FOR PRELIMINARY REVIEW**

No.	ISSUED FOR NYSDOH REVIEW	Revisors and Descriptions	By	Date
1.			DAH	4/29/21

Copyright © 2021 MRB Group All Rights Reserved

Project Title: **VILLAGE WATER SYSTEM IMPROVEMENT PROJECT 2020 VILLAGE OF DANSVILLE LIVINGSTON COUNTY, NEW YORK**

Drawing Title: **PLAN AND PROFILE**

Drawn By:	BJJ
Checked By:	GJH
Scale:	AS SHOWN
Date:	1/2021

**WEST AVENUE**

**MRB group**  
 Engineering, Architecture & Surveying, D.P.C.  
 The Culver Road Armory, 145 Culver Road,  
 Suite 160, Rochester, New York 14620  
 Phone: 585-381-9250  
 www.mrbgroup.com

Sheet No. **G-54**  
 of **TOT**  
 Project No. **0410.20002**